

TYPE: T6: 250 mm Wide x 150 mm High

Finned Element: 2 Qty. 75mm x 75mm on 22 mm Ø pipe

Heat out put is calculated by the following formula:


Water Flow temperature °C + Return °C ÷ 2 minus Air in temperature = Watts Output per metre of active finned element.

Example: 80°C Flow + 60°C Return temperature = 140°C ÷ 2 = 70°C less air temperature 20°C = 50°C ΔT

Watts at 30°CΔT	Watts at 40°CΔT	Watts at 50°CΔT	Watts at 60°CΔT
140	215	320	400

* Please note our units are tested to DIN EN 16430, test data available on request.

FINNED ELEMENT BANK LAYOUT

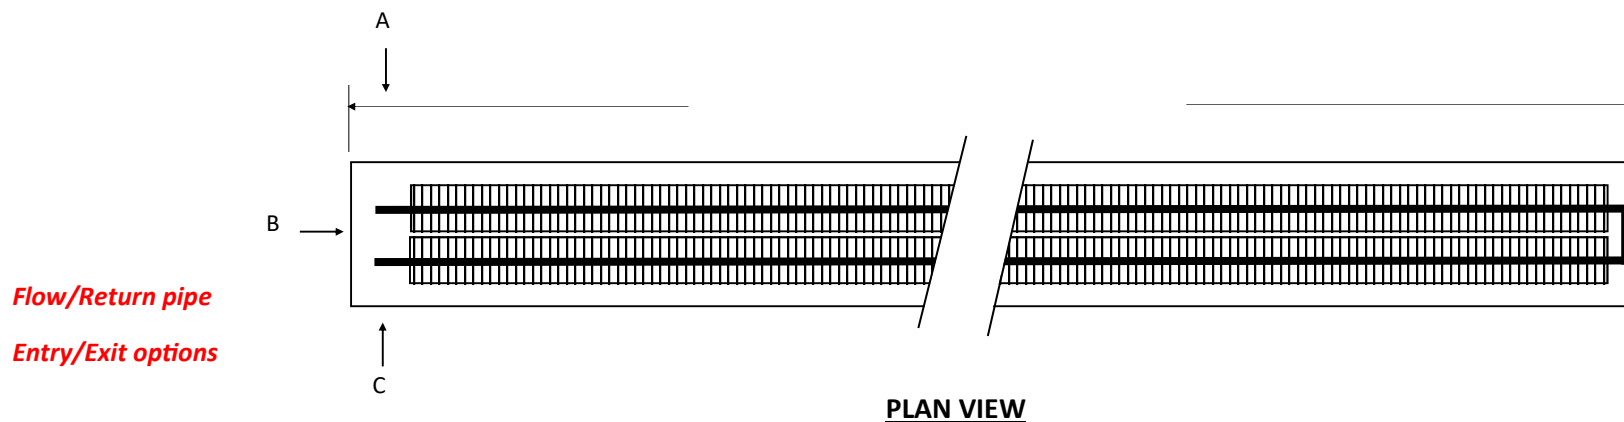

AIR VENTS ARE SUPPLIED LOOSE. ANY OTHER VALVES, CONTROLS TO BE SUPPLIED BY INSTALLER

PROJECT REFERENCE	
GRILLE	Natural Satin Anodised Aluminium
ANGLE	Natural Satin Anodised Aluminium
FINNED ELEMENT BANK	2 Qty: 75 mm x 75 mm
PIPE	22 mm Ø COPPER
TRENCH: WIDTH x HEIGHT	250 mm x 150 mm

Delivery address:

House No/Name:.....

Road:.....

Town/City:

Post Code:.....

Drawing Approval

Signature:.....

Date:.....



Unit 3, Pulloxhill Business Park
Greenfield Road Pulloxhill
Bedfordshire, MK45 5EU
Phone: 0044 (0) 1525 721431
Fax: 0044 (0) 1525 721428
Email: sales@trenchheating.com