

TYPE: T2: 300 mm Wide X 90 mm High
Finned Element: 2 Qty. 75 mm x 35 mm on 22 mm Ø pipe

Heat out put is calculated by the following formula:


Water Flow temperature °C + Return °C ÷ 2 minus Air in temperature = Watts Output per metre of active finned element.

Example: 80°C Flow + 60°C Return temperature = 140°C ÷ 2 = 70°C less air temperature 20°C = 50°C ΔT

Watts @	Watts @	Watts @	Watts @
30°CΔT	40°CΔT	50°CΔT	60°CΔT
137 w	220 w	302 w	396 w

* Please note our units are tested to DIN EN 16430, test data available on request.

FINNED ELEMENT BANK LAYOUT

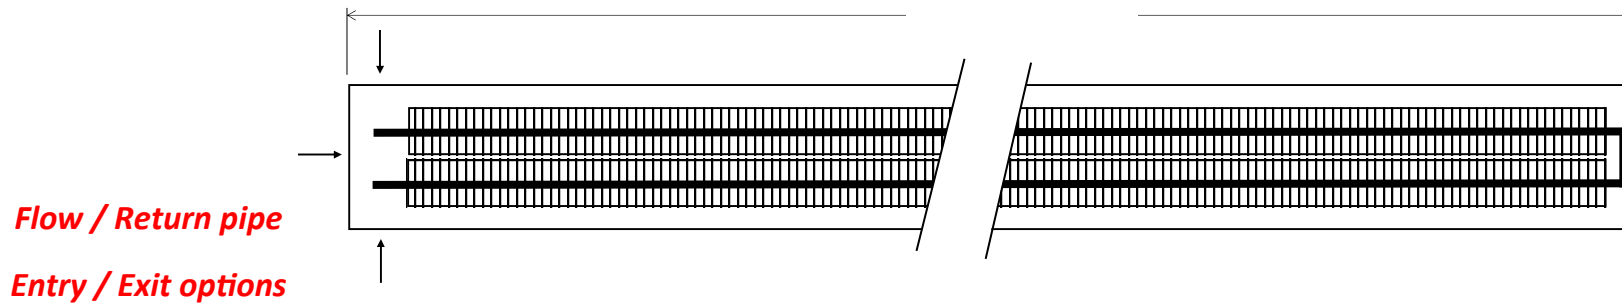

PLAN VIEW

AIR VENTS ARE SUPPLIED LOOSE. ANY OTHER VALVES, CONTROLS TO BE SUPPLIED BY INSTALLER

PROJECT REFERENCE	
GRILLE	Natural Satin Anodised Aluminium
ANGLE	Natural Satin Anodised Aluminium
FINNED ELEMENT BANK	2 Qty: 75 mm x 35 mm
PIPE	22 mm Ø COPPER
TRENCH WIDTH x HEIGHT	300 mm x 90 mm

Delivery address:
 House No/Name:.....
 Road:.....
 Town/City:
 Post Code:.....
Drawing Approval
 Signature:.....
 Date:.....



Unit 3, Pulloxhill Business Park
Greenfield Road Pulloxhill
Bedfordshire, MK45 5EU
Phone: 0044 (0) 1525 721431
Fax: 0044 (0) 1525 721428
Email: sales@trenchheating.com

***Please note our units are tested to DIN EN 16430, test data available on request**