

**TYPE: T5.OSR: 150 mm Wide x 150 mm High**

**Finned Element: 1 Qty. 75 mm x 75 mm on 22 mm ø pipe**

Heat out put is calculated by the following formula:


Water Flow temperature °C + Return °C ÷ 2 minus Air in temperature = Watts Output per metre of active finned element.

Example: 80°C Flow + 60°C Return temperature = 140°C ÷ 2 = 70°C less air temperature 20°C = 50°C ΔT

Watts @	Watts @	Watts @	Watts @
30°CΔT	40°CΔT	50°CΔT	60°CΔT
110 w	150 w	191 w	230 w

\* Please note our units are tested to DIN EN 16430, test data available upon request

## FINNED ELEMENT BANK LAYOUT

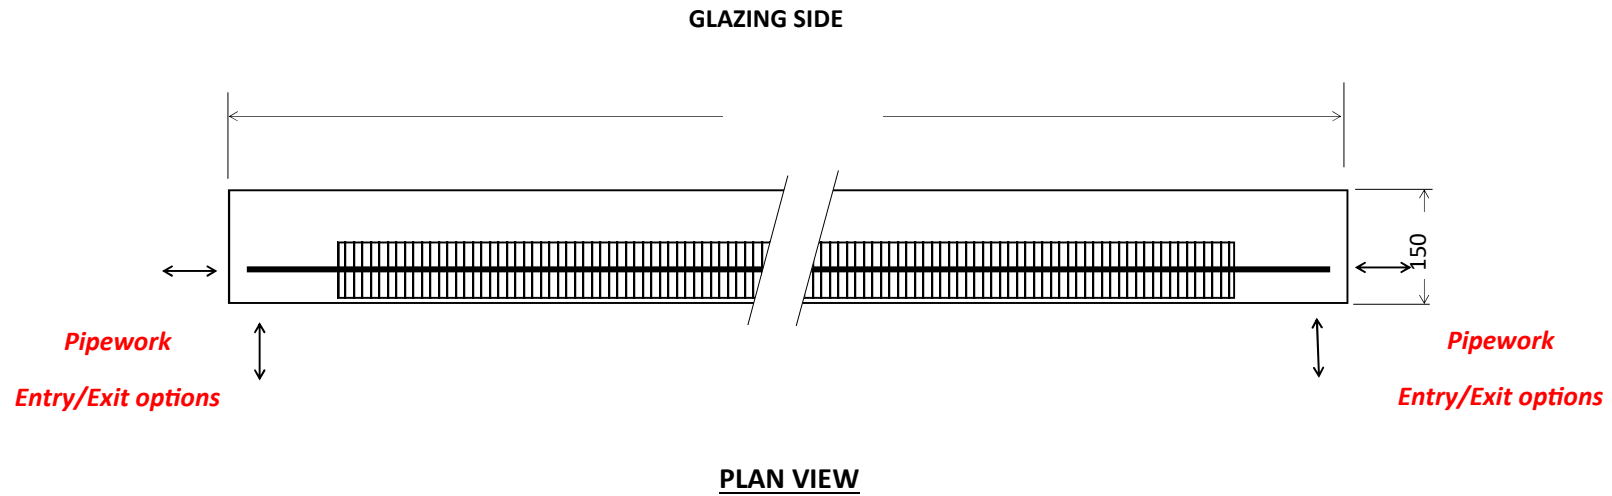

**AIR VENTS ARE SUPPLIED LOOSE. ANY OTHER VALVES, CONTROLS TO BE SUPPLIED BY INSTALLER**

PROJECT REFERENCE	
GRILLE	Natural Satin Anodised Aluminium
ANGLE	Natural Satin Anodised Aluminium
FINNED ELEMENT BANK	1 Qty: 75 mm x 75 mm
PIPE	22 mm Ø COPPER
TRENCH: WIDTH x HEIGHT	150 mm x 150 mm

**Delivery address:**

House No/Name:.....

Road:.....

Town/City: .....

Post Code:.....

**Drawing Approval.**

Signature:.....

Date:.....



Unit 3, Pulloxhill Business Park  
 Greenfield Road Pulloxhill  
 Bedfordshire, MK45 5EU  
 Phone: 0044 (0) 1525 721431  
 Fax: 0044 (0) 1525 721428  
 Email: sales@trenchheating.com

**\* Please note our units are tested to DIN EN 16430, test data available upon request**